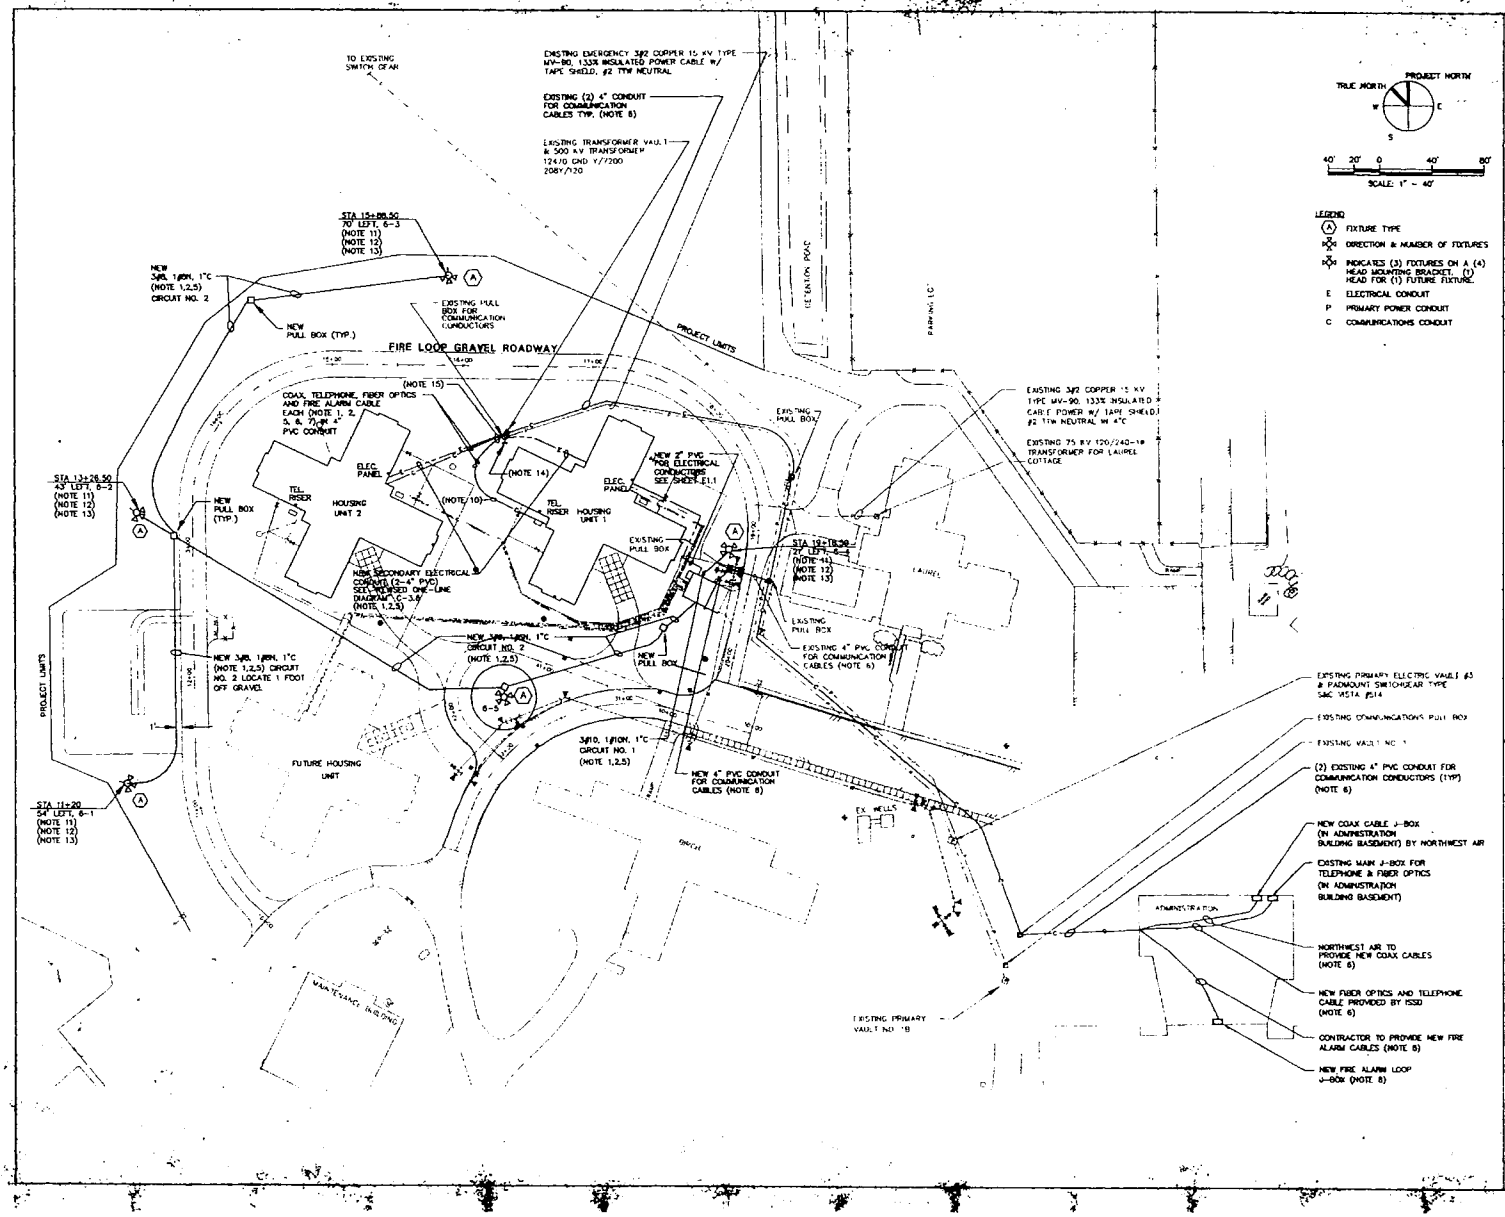

GENERAL NOTES

1. A REASONABLE ATTEMPT HAS BEEN MADE TO ACCURATELY LOCATE THE EXIST. UTILITIES. HOWEVER, THE EXACT LOCATION, AND/OR DEPTH IS UNKNOWN IN MOST INSTANCES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO FIELD VERIFY THE EXACT LOCATION OF EXISTING UTILITIES (HORIZONTAL AND VERTICAL). IF THE CONTRACTOR FINDS A CONFLICT BETWEEN EXISTING UTILITIES AND NEW IMPROVEMENTS, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE OWNER AS SOON AS POSSIBLE.
2. INSTITUTION DUMPSTERS SHALL NOT BE USED TO DISPOSE OF CONSTRUCTION RESIDUE MATERIAL OR PERSONAL TRASH. THE CONTRACTOR SHALL PROVIDE A DUMPSTER FOR HIS OWN USE. ALL COSTS FOR DUMPSTERS RENTAL AND DUMP FEES SHALL BE CONSIDERED INCIDENTAL TO THE PROJECT.
3. CONTRACTOR SHALL COORDINATE WITH BUILDING ELECTRICAL PLANS FOR EXACT LOCATION OF BUILDING PENETRATIONS.
4. CONTRACTOR SHALL SUPPLY (1) 200A/3Ø AND (1) 600A/3Ø S.U.S.E. BREAKERS IN SECONDARY SIDE OF EXISTING 500 KV TRANSFORMER. SEE ONE LINE DIAGRAM AND DETAILS ON SHEET C-3.6.
5. CONTRACTOR SHALL RESTORE SIDEWALKS, CURBING, ASPHALT OR GRASS PER TRENCH REPAIR DETAILS ON SHEET C3.3 AND OR AS SPECIFIED IN SPECIFICATIONS.
6. ISSD SHALL PROVIDE FIBER OPTICS & TELEPHONE CABLE FROM THE ADMINISTRATION BUILDING TO THE EXISTING PULL BOX NEXT TO BUILDING TRANSFORMER, AND MAINTENANCE BUILDING & THEN INTO THE NEW HOUSING UNITS. NORTHWEST AIR (JOHN KALNASY @ 425-745-8860) SHALL PROVIDE COAX CABLES TYPE RG59-U IN AND OUT FROM THE ADMINISTRATION BUILDING BASEMENT TO THE NEW HOUSING UNITS AND MAINTENANCE BUILDING SEE COAX CABLE DIAGRAM ON M2.4. CONTRACTOR SHALL COORDINATE WITH NORTHWEST AIR SO THEY CAN PROVIDE RG59-U COAX CABLE IN EXISTING COMMON 4" CONDUIT WITH FIRE ALARM, FIBER OPTICS AND TELEPHONE CABLE. CONTRACTOR SHALL COORDINATE WITH ISSD (RICH GREEN @ @ 360-902-7519). PROVIDE ALL COMMUNICATION CABLE IN 1 EXISTING 4" CONDUIT.
7. COORDINATE WITH BUILDING ELECTRICAL PLANS FOR COAX, TELEPHONE, FIBER OPTICS, AND FIRE ALARM CABLE INTERFACING.
8. CONTRACTOR SHALL PROVIDE (2) #18TSP (MORF) TO MATCH EXISTING FIRE ALARM LOOP IN INNERDUCT, IN EXISTING COMMON 4" PVC CONDUIT WITH OTHER COMMUNICATION CABLES. ROUTE FIRE ALARM CABLE FROM NEW FIRE ALARM LOOP J-BOX IN BASEMENT OF THE ADMINISTRATION BUILDING TO EXISTING PULL BOX ADJACENT TO THE NEW HOUSING UNITS TRANSFORMER & MAINTENANCE BUILDING. CONTRACTOR SHALL THEN PULL FIRE ALARM CABLE INTO THE NEW HOUSING UNITS AND MECHANICAL BUILDING. CONTRACTOR SHALL COORDINATE WITH NEW HOUSING UNITS FIRE ALARM INTEGRATOR FOR INTEGRATION INTO MAIN FIRE ALARM ANNUNCIATOR PANEL.
9. LIGHTING CONTROL PANEL SHALL BE PROVIDED IN MECHANICAL BUILDING PER BUILDING ELECTRICAL PLANS.
10. ALL LIGHTS SHALL BE PHOTOCELL CONTROLLED. CONTROL PANEL SHALL BE LOCATED IN MECHANICAL BUILDING.
11. LOCATION OF LIGHT POLES ARE APPROXIMATE. CONTRACTOR MAY CHOOSE TO VARY THE LOCATION ± 5 FEET IN ANY DIRECTION TO AVOID PHYSICAL OBSTRUCTIONS.
12. THE NUMBER CORRESPONDING TO A FIXTURE INDICATES THE ZONE AND FIXTURES NUMBER (IE. 6-1, ZONE 6 FIXTURE #1) CONTRACTOR SHALL PROVIDE TAGS ON FIXTURES TO MATCH EXISTING.
13. CONTRACTOR SHALL INSTALL (3) FIXTURES ON A (4) HEAD MOUNTING BRACKET. CONTRACTOR SHALL COORDINATE FINAL AIMING OF FIXTURES WITH OWNER.
14. STUB A 4" CONDUIT 10' OUT OF COMMUNICATION J-BOX @ 24" BELOW GRADE.
15. ALL POWER AND COMMUNICATION CROSSING SHALL BE SEPARATED BY A MINIMUM OF 1'-0" O.C.

MASIN SANFORD GIBELSE & SCHOENFELDT ARCHITECTS
510 SOUTH CAPITOL WAY, OLYMPIA, WA. 98501 (360) 943-8771 FAX: (360) 352-7005

Gray & Osborne, Inc.
CONSULTING ENGINEERS

SITE ELECTRICAL PLAN
NEW HOUSING UNITS FOR
MAPLE LANE SCHOOL
2831 OLD HIGHWAY 9 SW
CENTRALIA, WA. 98531-9669

STATE PROJECT NO. 98-402

C1.5